

# **Energy Management Energy Analyzer Type EM24 DIN**



- Protection degree (front): IP50
- RS485 serial output (on request) (MODBUS-RTU), iFIX SCADA compatibility
- Dupline communication capability (DP option)
- Application adaptable display and programming procedure (Easyprog function)
- Easy connections management
- Certified according to MID Directive, Annex "B"
   "Type examination" relevant to active electrical energy meters (see Annex MI-003).

- Class 1 (kWh) according to EN62053-21
- Class B (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy ±0.5 RDG (current/voltage)
- Energy analyzer
- Instantaneous variables readout: 4 DGT
- Energies/gas/water readout: 7+1 DGT
- System variables: VLL, VLN, Admd max, VA, VAdmd, VAdmd max, W, Wdmd, Wdmd max, var, PF, Hz, Phase-sequence.
- Single phase variables: VLL, VLN, A, VA, W, var, PF
- Energy measurements: total and partial kWh and kvarh or based on 4 different tariffs; single phase measurements
- Gas, cold water, hot water, kWh remote heating measurements
- Hour counter (6+2 DGT)
- TRMS measurements of distorted sine waves (voltages/currents)
- Self power supply (AV0-AV2-AV9 inputs)
- Auxiliary power supply (AV5-AV6 inputs)
- 3 digital inputs for tariff selection, DMD synch or gas/ water (hot-cold) and remote heating metering (on request)
- 2 digital outputs for pulses or for alarms or as a mix of them (on request)
- Dimensions: 4-DIN modules

Power supply

Option

Inputs/Outputs

#### **Product Description**

Three-phase energy analyzer with built-in configuration joystick and LCD data displaying; particularly indicated for active and reactive energy metering and for cost allocation. Housing for DIN-rail mounting with IP50 (front) protection degree. Direct connection up to 65A and by means of external current and potential trans-

formers. Moreover the meter can be provided with digital outputs that can be either for pulse proportional to the active and reactive energy being measured or for alarm outputs. In alternative the RS485 communication port and 3 digital inputs or Dupline port and 3 digital inputs are available as an option.

# How to order Model Range code System

#### Type Selection

#### Inputs/Outputs Range codes **System Power supply** AV5: 400V<sub>LL</sub> AC - 1/5 (10)A XX: 1: 1-phase, 2-wire; none (\*) X: Self power supply (CT connection) (\*) 3-phase, 3-wire, (See "Power supply 02: dual open collector $V_{LN}$ : 160 V to 480 $V_{LN}$ 3-phase, 4-wire type (dual pulse or one specifications") (\*) $V_{LL}\colon 277\ V$ to $830V_{LL}$ 18 to 60VAC/DC (48 balanced load (\*\*) pulse + one alarm or 1: 208V<sub>LL</sub> AC - 1/5(10)A to 62Hz) (\*\*) 115/230 VAC (48 to balanced and dual alarm) (\*) (VT/PT and CT unbalanced load: R2: dual relay type (func-D: connections) (\*) tions as per "O2") (\*\*)( °) 3-phase, 4-wire; 62Hz) (\*) $V_{LN}$ : 40V to 144 $V_{LN}$ Note: "L" and "D" power 3-phase, 3-wire; XS: RS485 port (\*\*) V<sub>LL</sub>: 70V to 250V<sub>LL</sub> 2-phase, 3-wire; 3 digital inputs for tariff supplies only for AV5 AV0: 208V<sub>LL</sub> AC -10(65)A 1-phase, 2-wire (\*) selection or Gas / and AV6 inputs; "X" (direct connection) (\*\*) water / remote heating power supply only **Options** V<sub>LN</sub>: 96V to 144V<sub>LN</sub> metering plus RS485 for AV0, AV2 and $V_{LL}\colon 166V$ to $250V_{LL}$ AV9 inputs. port (\*) AV2: 400V<sub>LL</sub>AC 10(65)A DP: Dupline port plus 3 P: Certified according (direct connection) (\*\*) to MID Directive, digital inputs for Gas / $V_{LN}$ : 113V to 265 $V_{LN}$ Annex "B" "Type water / remote heating $V_{LL}$ : 196V to 460 $V_{LL}$ examination" relevant metering (°°) AV9: 400V<sub>LL</sub> AC - 10(65)A to active electrical (direct connection) (\*) energy meters (see V<sub>LN</sub>: 184V to 276V<sub>LN</sub> Annex MI-003) (\*) $V_{LL}$ : 318V to 480 $V_{LL}$ X:

(\*) as standard. (\*\*) on request.

(°) not available if the range code is "AV2". (°°) available if the range code is either "AV2" or "AV5".

Specifications are subject to change without notice EM24 DIN DS 290708



# Input specifications

Rated inputs Current type	System type: 3-phase Galvanic insulation by means of built-in CT's (AV5 and AV6 models). By direct connec-	Type Instantaneous variables read-out Energies	LCD, h 7mm 4 DGT Imported Total/Partial/ Tariff: 7+1DGT or 8DGT;
Current range (by CT) Current range (direct) Voltage	tion (AV0, AV2 and AV9) AV5 and AV6: 1/5(10)A AV0: 10(65)A; AV2: 10(65)A; AV9: 10(65)A AV5: 400 VLL	Overload status	Exported Total/Partial/ Tariff: 6+1DGT or 7DGT (with "-" sign) EEEE indication when the value being measured is
Voltage	AV0: 120VLN/208 VLL AV2: 230/400 VLL AV9: 400 VLL		exceeding the "Continuous inputs overload" (maximum measurement capacity)
Voltage by VT/PT Accuracy (Display + RS485)	AV6: 120VLN/208 VLL  Ib: see below, Un: see below	Max. and Min. indication	Max. instantaneous variables: 9999; energies:
(@25°C±5°C, R.H. ≤60%, 48 to 62Hz) AV5 model	In: 5A, Imax: 10A; Un: 160 to 480VLN (277 to 830VLL)		9 999 999.9 or 99 999999. Min. instantaneous vari- ables: 0.000; energies 0.0
AV6 model  AV0 model	In: 5A, Imax: 10A; Un: 40 to 144VLN (70 to 250VLL)	LEDs  AV5, AV6 models	Red LED (Energy consumption) 0.001 kWh/kvarh by pulse if
AV2 model	Ib: 10A, Imax: 65A; Un: 96 to 144VLN (166 to 250VLL) Ib: 10A, Imax: 65A, Un: 113	Avo, Avo models	CT ratio by VT ratio is ≤7; 0.01 kWh/kvarh by pulse if CT
AV9 model	to 265VLN (196 to 460VLL) lb: 10A, Imax: 65A; Un: 184 to 276VLN (318 to 480VLL)		ratio x VT ratio is $> 7.1 \le 70.0$ ; 0.1 kWh/kvarh pulse if CT ratio x VT ratio is $> 70.1 \le 700.0$ ;
Current	10 27 0 1214 (0 10 10 400 122)		1 kWh/kvarh by pulse if CT
AV5, AV6 models	From 0.002In to 0.2In: ±(0.5% RDG +3DGT) From 0.2In to Imax: ±(0.5% RDG +1DGT).	AV0, AV2, AV9 models Max frequency	ratio x VT ratio is > 700.1; 0.001kWh/kvarh by pulse 16Hz, according to EN50470-3
AV0, AV2, AV9 models	From 0.004lb to 0.2lb: ±(0.5% RDG +3DGT)	Measurements	See "List of the variables that can be connected to:"
Phase-neutral voltage  Phase-phase voltage	From 0.2lb to Imax: ±(0.5% RDG +1DGT). In the range Un: ±(0,5% RDG +1DGT) In the range Un: ±(1% RDG	Method Coupling type	TRMS measurements of distorted wave forms.  Direct for AV0, AV2 and AV9 models. By means of exter-
Frequency	+1DGT) ±0.1Hz (45 to 65Hz)	Crest factor	nal CT's for AV5 and AV6  Ib 10A ≤4 (91A max. peak) In 5A ≤3 (15A max. peak)
Active and Apparent power Power Factor	±(1%RDG +2DGT) ±[0.001+1%(1.000 - "PF	Current Overloads Continuous	1/5(10) A: 10A, @ 50Hz
Reactive power Active energy	RDG")] ±(2%RDG +2DGT) Class 1 according to EN62053-21 and MID	For 500ms For 10ms	10(65) A: 65A, @ 50Hz 1/5(10) A: 200A, @ 50Hz 10(65) A: 1920A max, @ 50Hz
Reactive energy	Annex MI-003 Class B according to EN50470-3 Class 2 according to EN62053-23	Voltage Overloads Continuous For 500ms	1.2 Un 2 Un
AV5, AV6 models	In: 5A, Imax: 10A; 0.1 In: 0.5A,	Input impedance 208VL-L (AV6) 208VL-L (AV0)	>1600KΩ Refer to "Power
AV0, AV2, AV9 models	Start up current: 10mA lb: 10A, lmax: 65A; 0.1 lb: 1.0A Start up current: 40mA	230/400VL-L (AV2) 400VL-L (AV5)	Consumption" Refer to "Power Consumption" >1600ΚΩ
Energy additional errors Influence quantities	According to EN62053-21, EN50470-3, EN62053-23	400VL-L (AV9) 1/5(10)A (AV5-AV6)	Refer to "Power Consumption" < 0.3VA
Temperature drift	≤200ppm/°C	10(65)A (AV0-AV2-AV9)	< 4VA
Sampling rate	1600 samples/s @ 50Hz 1900 samples/s @ 60Hz	Frequency Joystick	45 to 65 Hz For variable selection and
Display refresh time	750 ms		programming of the
Display	3 lines (1 x 8 DGT; 2 x 4 DGT)		instrument working parameters



# **Output specifications**

Digital outputs		Note	The meters equipped with
Pulse type Number of outputs	Up to 2, independent. Programmable from 0.001 to 10.00kWh/kvarh by pulse.		the relay outputs ("AV0" and "AV9" models with "R2" option) work even if VL3 is missing (VL1, VL2 and neutral have to be
Туре	Outputs connectable to the energy meters (kWh/kvarh)		available)(see table "work- ing mode notes")
Pulse duration	≥100ms < 120msec (ON),	RS485	<u> </u>
	≥120ms (OFF), according to EN62053-31	Туре	Multidrop, bidirectional (static and dynamic
Alarm type	Unite O independent		variables)
Number of outputs Alarm modes	Up to 2, independent Up alarm, down alarm (see	Connections	2-wire Max. distance 1000m
	the table "List of the	Addresses	247, selectable by means
	variables that can be	, 13 31 33 33	of the front joystick
Cat point adjustment	connected to") From 0 to 100% of the	Protocol	MODBUS/JBUS (RTU)
Set-point adjustment	display scale	Data (bidirectional)	
Hysteresis	From 0 to full scale	Dynamic (reading only)	System and phase
On-time delay	0 to 255s		variables: see table "List of variables"
Output status	Selectable; normally	Static (reading and writing)	All the configuration
	de-energized or normally	Static (reading and writing)	parameters.
Min roomanaa tima	energized	Data format	1 start bit, 8 data bit, no
Min. response time	≤ 700ms, filter excluded, set-point on-time delay: "0 s"	<b>5</b>	parity,1 stop bit
Note	The 2 digital outputs can	Baud-rate Driver input impedance	4800, 9600 bit/s 1/5 unit load
	also work as a dual pulse	Driver input impedance	Maximum 160 transceivers
	output, dual alarm output,		on the same bus.
	one pulse output and one alarm output.	Insulation	By means of optocouplers, 4000 VRMS output to
Static output			measuring input,
Purpose	For pulse output or alarm		4000 VRMS output to
Signal	output V <sub>ON</sub> 1.2 VDC/ max. 100 mA	Mate	power supply input.
Signal	V <sub>OFF</sub> 30 VDC max.	Note:	The meters equipped with the communication port
Insulation	By means of optocuplers,		("AV0" and "AV9" models
	4000 VRMS output to		with "XS" and "IS" options)
	measuring inputs,		work even if VL3 is missing
	4000 VRMS output to		(VL1, VL2 and neutral have
Relay output	power supply input.		to be available)(see table
Purpose	For alarm output or pulse		"working mode notes")
. d.pece	output		
Туре	Relay, SPST type AC 1-5A @ 250VAC		
	DC 12-5A @ 24VDC		
	AC 15-1.5A @ 250VAC		
Insulation	DC 13-1.5A @ 24VDC 4000 VRMS output to		
modiation	4000 VIIVIS Output to		

measuring input 4000 VRMS output to power supply input.



#### **Dupline specifications**

Counters			variables)
Used Dupline function	Multiplexer for counter val-		M1 to N8 (4 <sup>th</sup> group of 16
•	ues		variables)
Number of counters	6 per instrument		O1 to P8 (5th group of 16
_	128 per network		variables)
Counter range	0 99 999 999	Available variables	All, except for the "max"
Used channels	B to F		variables
Multiplexer	B2 to B8 B1	Synchro/Tariff input	
Reset Value	C1 to F8	Used Dupline functions	Monostable (push-button)
Counter reset	Enable/disable function for		Realtime
Counterreset	all the counters	Used channels	A5
Available counters	kWh totkWh tot.	Working mode	Selectable:
/ Wallabio Courtoro	kvarh tot, -kvarh tot,		• none
	kWh t1, kWh t2,		Wdmd synchronization     total and partial appropri
	kWh L1, kWh L2, kWh L3,		<ul> <li>total and partial energy meter (kWh, kvarh) man-</li> </ul>
	counter dig. in. 1,		aged by time periods (t1-t2).
	counter dig. in. 2,	Alarms	aged by time periods (t1-t2).
	counter dig. in. 3,	Used Dupline function	Manastable (push button)
	hour counter.	Used channells	Monostable (push-button) Selectable (A1 to P8). No
Analogue variables		Osed Charmens	control that the selected
Used Dupline function	Multiplexer for analogue		channels are not used for
N	values		counters or analog vari-
Number of variables	8 per instrument		ables.
	80 per network	Number of alarms	2 per instrument
Dupline data format	3 1/2 DGT BCD	Alarm modes	Up alarm, down alarm (see
Full scale value	Selectable from 1.999 to		the table "List of the
Used channels	1999M		variables that can be
Osed channels	depending on the number of variables	Cat is a just a discretiza a int	connected to")
Multiplexer	A1 to A4	Set-point adjustment	From 0 to 100% of the display scale
Value	G1 to H8 (1st group of 16	Hysteresis	From 0 to full scale
1 4.10.0	variables)	On-time delay	0 to 255s
	I1 to J8 (2 <sup>nd</sup> group of 16	Output status	Normally energised
	variables)	Available variables	All, except for the "max"
	K1 to L8 (3 <sup>th</sup> group of 16		variables

#### **Digital input specifications**

Number of inputs Input frequency Prescaler adjustment

Contact measuring voltage Contact measuring current Input impedance Contact resistance

Working modes (DP version excluded)

20Hz max, duty cycle 50% From 0.1 to 999.9 m³ or kWh per pulse 5VDC +/- 5% 10mA max  $680\Omega$  ≤100 $\Omega$ , closed contact ≥500k $\Omega$ , open contact

#### Selectable:

• total and partial energy meters (kWh and kvarh) without digital inputs;

• total and partial energy meters (kWh and kvarh) managed by time periods (t1-t2-t3-t4), W dmd synchronisation (the synchronisation is made every time the tariff changes) and GAS (m³) or WATER (hotcold m³) or remote heating (kWh) meters;

 total and partial energy meters (kWh and kvarh) Working modes (DP version only)

Note

Insulation

(t1-t2), W dmd synchronisation (the synchronisation is made independently from the tariff selection) and GAS (m³) or WATER (hot-cold m³) or remote heating (kWh) meters;
• total energy (kWh, kvarh) and GAS, WATER (hot-cold m³) and remote heating meters (3 choices only).

managed by time periods

Selectable:

• GAS (m³) or WATER (hotcold m³) or remote heating (kWh) meters
The energy metering is only made by means of the analogue inputs.
By means of optocouplers, 4000 VRMS digital inputs to measuring inputs, 4000 VRMS digital inputs to power supply input.



# **Software functions**

Password	Numeric code of max. 4	Operating range	0 to 100% of the input dis-
1st level	digits; 2 protection levels of the programming data: Password "0", no	Filtering coefficient Filter action	play scale 1 to 32 Measurements, serial output
2nd level	protection Password from 1 to 9999,		(fundamental variables: V, A, W and their derived ones).
System selection System 3-Pn unbalanced load System 3-P unbalanced load System 3-P.1 (only AV5 and AV6) balanced load  System 2-P	3-phase (4-wire) 3-phase (3-wire) 3-phase (3-wire) one current and 3-phase to phase voltage measurements 3-phase (4-wire) one current and 1-phase (L1) to neutral voltage measurement 2-phase (3-wire)	Displaying  Reset	Up to 3 variables per page (see « Display pages ») 8 different set of variables available (see « Display pages ») according to the application being selected By means of the front joystick:  - dmd and dmd max;  - total energies (kWh and kvarh) and gas/water;  - partial energies and
System 1-P	1-phase (2-wire)		tariffs: kWh, kvarh
Transformer ratio VT (PT) CT  Filter	1.0 to 999.9 / 1000 to 6000 (only AV5 and AV6) 1.0 to 999.9 / 1000 to 9999 / 10.00k to 60.00k (only AV5 and AV6). The maximum power being measured cannot exceed 210 MW (calculated as maximum input voltage and current, see the "Accuracy" paragraph before). The maximum VT by CT ratio is 48600. For MID complaint applications the maximum power being measured is 25MW.	Easy connection function AV0, AV2 and AV9 models AV5-AV6-AV0-AV2-AV9 models	Automatic phase sequence detection with current and voltage synchronisation. For all the display selections, both energy and power measurements are independent from the current direction. The displayed energy is always "imported" with the only exception of "F" and "H" types (see "display pages" table). For those latter selections the energies can be either "imported" or "exported" depending on the current direction.

# **General specifications**

Operating temperature	-25°C to +55°C (-13°F to	Dielectric strength	4000 VRMS for 1 minute				
	131°F) (R.H. from 0 to 90%	Noise rejection CMRR	100 dB, 48 to 62 Hz				
	non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-23	EMC Electrostatic discharges Immunity to irradiated	According to EN62052-11 15kV air discharge Test with current: 10V/m from 80 to 2000MHz				
Storage temperature	-30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-	Electromagnetic fields Burst	Test without any current: 30V/m from 80 to 2000MHz On current and voltage measuring inputs circuit:				
	23	Immunity to conducted	4kV				
Installation category	Cat. III (IEC60664, EN60664)	disturbances	10V/m from 150KHz to 80MHz				
Insulation (for 1 minute)	4000 VRMS between measuring inputs and power supply 4000 VRMS between power supply and RS485/digital output	Surge  Radio frequency suppression	On current and voltage measuring inputs circuit: 4kV; on "L" auxiliary power supply input: 1kV According to CISPR 22				



# **General specifications (cont.)**

Standard compliance Safety Metrology	IEC60664, IEC61010-1 EN60664, EN61010-1 (EN62052-11) EN50470-1. EN62053-21, EN62053-23, EN50470-3.	Cable cross-section area AV5-AV6 models	Min./Max. screws tightening torque: 0.4 Nm / 0.8 Nm  Max. 1.5 mm <sup>2</sup> Min./Max. screws tightening torque: 0.4 Nm / 0.8 Nm
Pulse output Approvals	MID "annex MI-003" DIN43864, IEC62053-31 CE, MID according to "annex B" (EC type certificate)	Housing DIN Dimensions (WxHxD) Material Mounting	71 x 90 x 64.5 mm Nylon PA66, self-extinguishing: UL 94 V-0 DIN-rail
Connections Cable cross-section area AV0-AV2-AV9 models	Screw-type  Max. 16 mm²; Min. 2.5 mm² (measuring inputs); Min./Max. screws tightening torque: 1.7 Nm / 3 Nm Other inputs: 1.5 mm²	Protection degree Front Screw terminals Weight	IP50 IP20 Approx. 400 g (packing included)

# **Power supply specifications**

with "IS" and "R2" options work only if all the voltage inputs are connected (3- phase and neutral) if a 1-  (IS and DP option only)  AV5-AV6 models  ≤ 2VA/2W  ≤ 2VA/2W
--


# Working mode notes (only "Self power supply" version)

Output	Model	Note				
Open collector output	"AV0" and "AV9" models with "O2" option	The meter works even if up to two voltages "phase to neutral" are missing or if one voltage "phase to phase" is missing.				
Relay output	"AV0" and "AV9" models with "R2" option	The neutral wire has always to be available. T meter works even if "Phase 3" is missing bu				
RS485 port	"AV0" and "AV9" models with "XS" and "IS" options	mandatorily, both "phase 1" and "Phase 2" have to be available.				
Dupline port	"AV2" model with "DP" option	The meter works even if up to two voltages "phase				
Relay output	"AV2" model with "R2" option	to neutral" are missing or if one voltage "phase to				
RS485 port	"AV2" model with "XS", "IS" options	phase" is missing.				




# Accuracy (According to EN50470-3 and EN62053-23)

kWh, accuracy (RDG) depending on the current

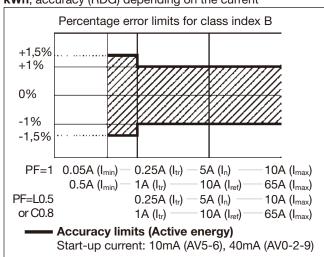

kvarh, accuracy (RDG) depending on the current

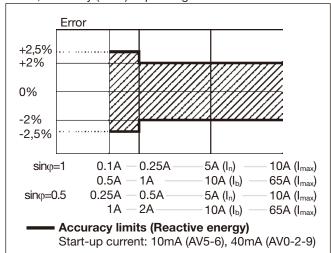

#### MID "Annex MI-003" compliance

**Accuracy** 

 $0.9 \text{ Un} \le U \le 1.1 \text{ Un};$  $0.98 \text{ fn} \le f \le 1.02 \text{ fn};$ fn: 50 or 60Hz; cosφ: 0.5 inductive to 0.8

AV0-AV2-AV9 models

capacitive. Class B I st: 0.04A: I min: 0.5A; I tr: 1A; I ref: 10A;

I max: 65A.

AV5-AV6 models Class B I st: 0.01A: I min: 0.05A; I tr: 0.25A; I ref: 5A; I max: 10A. Operating temperature -25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C) **EMC** compliance E2

#### **Used calculation formulas**

#### Phase variables

Instantaneous effective voltage

$$V_{1N} = \sqrt{\frac{1}{n} \cdot \sum_{1}^{n} (V_{1N})_{i}^{2}}$$
  
Instantaneous active power

$$W_1 = \frac{1}{n} \cdot \sum_{1}^{n} \left( V_{1N} \right)_i \cdot \left( A_1 \right)_i$$

Instantaneous power factor

$$\cos \varphi_1 = \frac{W_1}{VA_1}$$

Instantaneous effective current

$$A_1 = \sqrt{\frac{1}{n} \cdot \sum_{i=1}^{n} (A_i)_i^2}$$

Instantaneous apparent power

$$V\!A_1 = V_{1N} \cdot A_1$$

Instantaneous reactive power

$$var_1 = \sqrt{(VA_1)^2 - (W_1)^2}$$

#### System variables

Equivalent three-phase voltage

$$V_{\Sigma} = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$$

Voltage asymmetry

$$ASY_{LL} = \frac{(V_{LL\,max} - V_{LL\,min})}{V_{LL} \Sigma}$$

$$ASY_{LN} = \frac{(V_{LN \, max} - V_{LN \, min})}{V_{LN} \, \Sigma}$$

Three-phase reactive power

$$var_{\Sigma} = (var_1 + var_2 + var_3)$$

Three-phase active power

$$W_{\Sigma} = W_1 + W_2 + W_3$$

Three-phase apparent power

$$VA_{\Sigma} = \sqrt{W_{\Sigma}^2 + \text{var}_{\Sigma}^2}$$

Three-phase power factor

(TPF)

$$\cos \varphi_{\Sigma} = \frac{W_{\Sigma}}{VA_{\Sigma}}$$

#### **Energy metering**

$$k \operatorname{var} hi = \int_{t_1}^{t_2} Qi(t) dt \cong \Delta t \sum_{t_1}^{n_2} Qnj$$

$$kWhi = \int_{t_1}^{t_2} Pi(t) dt \cong \Delta t \sum_{j=1}^{n_2} Pnj$$

#### Where:

i= considered phase (L1, L2 or L3) P= active power; Q= reactive power;  $t_1$ ,  $t_2$  =starting and ending time points of consumption recording; n= time unit;∆t= time interval between two successive power consumptions;  $n_1$ ,  $n_2$  = starting and ending discrete time points of consumption recording



#### List of the variables that can be connected to:

- RS485 communication port
- Alarm outputs ("max" variable", "energies" and "hour counter" excluded)
  Pulse outputs (only "energies")
- Dupline bus

No	Variable	1-phase system	2-phase system	3-ph. 4-wire balanced sys	3-ph. 4-wire unbal. sys.	e 3 ph. 3-wire 3 ph. 3-wir bal. sys. unbal. sy		Notes
1	V L-N sys	0	Х	Х	Х	Х	#	sys=system
2	V L1	Х	Х	Х	Х	X	#	
3	V L2	0	X	Х	Х	X	#	
4	V L3	0	0	Х	х	X	#	
5	V L-L sys	0	X	Х	х	X	Х	sys=system
6	V L1-2	#	X	Х	Х	X	Х	
7	V L2-3	#	0	Х	Х	X	Х	
8	V L3-1	#	0	Х	Х	X	Х	
9	A dmd max	0	X	Х	Х	Х	х	Highest "dmd" current among the phases (1)(2)
10	A L1	Х	X	Х	Х	X	Х	
<u>11</u>	A L2	0	X	Х	Х	X	Х	
12	A L3	0	0	Х	Х	X	X	
13	VA sys	Х	X	Х	Х	X	Х	sys=system
14	VA sys dmd	Х	X	Х	Х	X	X	sys=system (1)
15	VA L1	Х	X	Х	Х	X	#	
16	VA L2	0	X	X	Х	X	#	
17	VA L3	0	0	Х	Х	X	#	
18	var sys	Х	X	X	Х	X	#	sys=system
19	var L1	Х	X	Х	Х	X	#	
20	var L2	0	X	Х	Х	X	#	
21	var L3	0	0	X	Х	X	#	
22	W sys	Х	X	Х	Х	X	Х	sys=system
23	W sys dmd	Х	X	Х	Х	X	Х	sys=system (1)
24	W L1	Х	X	Х	Х	X	#	
25	W L2	0	Х	Х	Х	X	#	
26	W L3	0	0	Х	Х	X	#	
27	PF sys	Х	X	Х	Х	X	Х	
28	PF L1	Х	X	Х	Х	X	#	
29	PF L2	0	X	X	Х	X	#	
30	PF L3	0	0	Х	Х	X	#	
31	Hz	Х	X	Х	Х	X	Х	
32	Phase seq.	0	X	Х	Х	X	X	
33	Hours	Х	X	Х	Х	X	Х	
34	kWh (+)	х	X	X	Х	X	Х	Total or by user
35	kvarh (+)	Х	X	Х	х	X	#	Total or by user
36	kWh (+)	х	X	X	Х	X	Х	Partial or by tariff
37	kvarh (+)	Х	X	Х	х	X	#	Partial or by tariff
38	kWh (-)	Х	X	Х	х	X	Х	Total
39	kvarh (-)	Х	Х	Х	Х	Х	#	Total
40	m³ Gas	Х	Х	Х	Х	Х	Х	Total
41	m³ Cold H₂O	Х	Х	Х	Х	Х	Х	Total
42	m³ Hot H₂O	Х	Х	Х	Х	Х	Х	Total
43	kWh H₂O	Х	Х	Х	Х	Х	Х	Total

<sup>(</sup>x) = available

<sup>(</sup>o) = not available (zero indication on the display)

<sup>(#) =</sup> not available (the relevant page is not displayed)

<sup>(1) =</sup> max. value with data storage

<sup>(2) =</sup> not available with the "DP" option



#### **Display pages**

Sel.	NI-	1st variable	2nd variable	3rd variable	No. Lo			Ap	plic	atio	ns		
pos.	No	(1st line)	(2nd line)	(3rd line)	Note	Α	В	С	D	Ε	F	G	Н
	1	Phase seq.	VLN sys	Hz		7	7	7		7	7	7	7
	2	Phase seq.	VLL sys	Hz							Х	Х	Х
	3	Total kWh (+)	W sys dmd	W sys dmd max		Х	Х	Х		Х	Х	Х	х
	4	kWh (+)	A dmd max	(text) "PArt"	"PArt" = Partial kWh (+)						Х	Х	Х
	5	Total kvarh (+)	VA sys dmd	VA sys dmd max			7	7			7	7	7
	6	kvarh (+)	VA sys	(text) "PArt"	"PArt" = Partial kvarh (+)						7	7	7
	7	Totalizer 1 (2)	W sys	(text) (3)	(1)			Х			Х	Х	х
	8	Totalizer 2 (2)	W sys	(text) (3)	(1)			Х			Х	Х	Х
	9	Totalizer 3 (2)	W sys	(text) (3)	(1)			Х			Х	Х	х
	10	kWh (+)	t1 tariff (4)	W sys dmd	(1) digital input enabled			Х			Х	Х	Х
	11	kWh (+)	t2 tariff (4)	W sys dmd	(1) digital input enabled			Х			Х	Х	х
	12	kWh (+)	t3 tariff (4)	W sys dmd	(1) digital input enabled			5			5	5	5
	13	kWh (+)	t4 tariff (4)	W sys dmd	(1) digital input enebled			5			5	5	5
	14	kvarh (+)	t1 tariff (4)	W sys dmd	(1) digital input enabled			7			7	7	7
	15	kvarh (+)	t2 tariff (4)	W sys dmd	(1) digital input enabled			7			7	7	7
	16	kvarh (+)	t3 tariff (4)	W sys dmd	(1) digital input enabled			5,7			5,7	5,7	5,7
	17	kvarh (+)	t4 tariff (4)	W sys dmd	(1) digital input enabled			5,7			5,7	5,7	5,7
	18	kWh (+) X	WX	User X	(1) specific function enabled				Х				
	19	kWh (+) Y	WY	User Y	(1) specific function enabled				Х				
	20	kWh (+) Z	WZ	User Z	(1) specific function enabled				Х				
	21	Total kvarh (-)	VA sys dmd	VA sys dmd max							7		7
	22	Total kWh (-)	W sys dmd	W sys dmd max						Х	Х		х
	23	Hours	W sys	PF sys						Х	Х	Х	х
	24	Hours	var sys	PF sys						7	7	7	7
	25	var L1	var L2	var L3								7	7
	26	VA L1	VA L2	VA L3								7	7
	27	PF L1	PF L2	PF L3								7	7
	28	W L1	W L2	W L3						7		7	7
	29	A L1	A L2	A L3						Х		Х	х
	30	V L1-2	V L2-3	V L3-1								6	6
	31	31 VL1 VL2 VL3 7 7 7 7 7											
0	Sel	Selector position which can be linked to any of the variable combinations listed above (No. from 1 to 31)											
1	Sele	ector position wh	ich can be linked	d to any of the va	riable combinations listed abov	e (N	o. fr	om '	l to	31)			
2	Sele	ector position wh	ich can be linked	d to any of the va	riable combinations listed abov	e (N	o. fr	om 1	l to	31)			
3					riable combinations listed abov ne reactive energy (kvarh) being				l to	31)			

<sup>(1)</sup> The page is available according to the enabled measurement.

- (2) m³ Gas, m³ Water, kWh remote heating.
- (3) Hot and Cold (water), GAS.
- (4) The active tariff is displayed with an "A" before the "t1-t2-t3-t4" symbols.
- (5) These pages are not available in case of Dupline system.
- (6) Pages not available in case of 1-phase sysem (1P selection).
- (7) Pages not available in case of 3-phase unbalanced system (3P selection).

**Note:** in case of alarm the whole display blinks. The blinking stops when either the selector or the joystick are used. The display starts to blink again after 60 seconds of the last command being used. There is a time-out of 60s that brings the scrolled page to the default one (selectable according to the table given above).



#### Additional available information on the display

Туре	1st line	2nd line	3rd line
Meter information	Firmware revision	YEAr (text)	Year of production
Meter information	PuLSE (text)	LEd (text)	Numb. of kWh per pulse
Meter information	System (1-2-3-phase)	Connection (2-3-4-wire)	dmd (time)
Meter information	VT/PT ratio		
Meter information (AV5-6)	Ct rAtio (text)	1.0 60.0k	
Meter information (AV5-6)	UT rAtio (text)	1.06.0k	
In case of communication port	SEriAL (text)	Address number	RS485 status (RX-TX)
In case of Dupline port	Dupline (text) or EM24 (text)	OK err	

### List of selectable applications

Description	Notes
Basic domestic	Mainly energy metering
Shopping centres	Mainly energy metering
Advanced domestic	Mainly energy metering (total and based on tariff), gas and water metering
Multi domestic (also camping and marinas)	Mainly energy metering (3 by single phase)
Solar	Energy meter with some basic power analyzer functions
Industrial	Mainly energy metering
Advanced industrial	Energy metering and power analysis
Advanced industrial for power generation	Complete energy metering and power analysis
	Basic domestic Shopping centres Advanced domestic Multi domestic (also camping and marinas) Solar Industrial Advanced industrial

#### Insulation between inputs and outputs

	Measuring Inputs	Relay outputs	Open collector outputs	Comm. port and digital inputs	Dupline	Self power supply	Auxiliary power supply
Measuring Inputs	-	4kV	4kV	4kV	4kV	0kV	4kV
Relay outputs	4kV	-	-	-	-	4kV	4kV
Open collector outputs	4kV	-	-	-	-	4kV	4kV
Comm. port and digital inputs	4kV	-	-	-	-	4kV	4kV
Dupline	4kV	-	-	-	-	4kV	4kV
Self power supply	0kV	4kV	4kV	4kV	4kV	-	-
Aux. power supply	4kV	4kV	4kV	4kV	4kV	-	-

**NOTE:** all the models with auxiliary power supply have, mandatorily, to be connected to external current transformers because the isolation among the current inputs is just functional (100VAC).

# Tamper proof accessory kit



The "tamper proof" kit is available with the "P" option (two screw protection covers).


The instrument can be sealed in three points:

- Upper cover;
- Lower cover;
- Front selector (to lock the instrument programming);







#### **Wiring diagrams**




#### (65A) System type selection: 3P.n




#### (65A) System type selection: 3P




#### (65A) System type selection: 2P




#### (65A) System type selection: 1P







"AV2" input range.

(10A) System type selection: 3P.n












# **Wiring diagrams**


#### (10A) System type selection: 3P.n








# 3-ph, 3-wire, unbalanced load **Fig. 11**1 5 3 8 9 10 11 2 13 2-CT and 2-VT/PT connections ARON





(10A) System type selection: 3P.1






#### (10A) System type selection: 2P






#### (10A) System type selection: 1P







#### Wiring diagrams


(10A) System type selection: 1P










#### Power supply wiring diagrams (auxiliary power supply)









# Open collector and relay outputs wiring diagrams










The load resistances (RC) must be designed so that the close contact current is lower than 100mA; the VDC voltage must be lower than or equal to 30VDC.




### Digitala inputs, RS485 and Dupline ports wiring diagrams






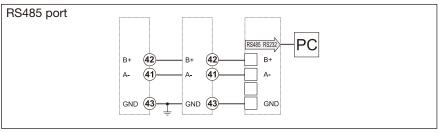

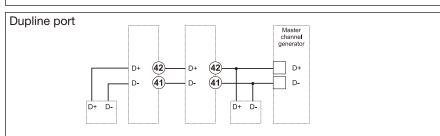

#### Front panel description

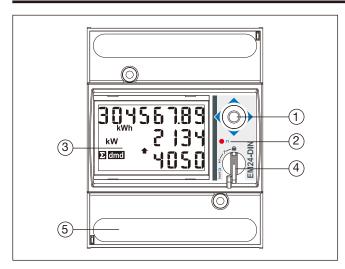

- 1. Joystick
  - To program the configuration parameters and scroll the variables on the display.
- 2. LED

Red LED blinking proportional to the energy being measured.

- 3. Display
  - LCD-type with alphanumeric indications to:
  - display configuration parameters;
  - display all the measured variables.
- 4. Selector

To select the desired display pages and to lock the programming.

5. Connections

Screw terminal blocks for instrument wiring.

#### **Dimensions**

