



ENERIUM®

POWER MONITORS



- Communication and programming via optical interface, or remotely via **Ethernet network** or RS485 output
 - **Energy:** measurement on all 4 quadrants in class 0.5s according to IEC 62053-22
 - Up to 8 load curves
 - Up to 4 trend curves
 - **Display of harmonics** by order
 - 8 inputs / outputs as required
 - Up to 8 configurable alarms
 - Log of last 64 events
 - Possibility of upgrading the embedded software via the **optical interface**
 - **Graphic display** (Enerium 150 only): Fresnel diagram, harmonics in bargraph form, U, I and P displayed as gauges
 - Version without display for mounting in cabinet

**ETHERNET
COMMUNICATION**

The Range

- The ENERIUM range comprises six power monitors, including two without a display.



Enerium 50

96 x 96 format

- Harmonics up to 25th order
- 2 inputs or 2 outputs
- 8 load curves

742



Enerium 100/110

144 x 144 format

- Harmonics up to 25th order
- 4 inputs/4 outputs
- 4 trend curves
- Neutral current measurement

572

- Measurement of the 1s, min., max. and avg. values of the electrical quantities
- Energy metering in all 4 quadrants
- Measurement of harmonics by order up to the 25th order
- Measurement of THD-U, THD-V and THD-I, crest factor and composite voltage unbalance
- Measurement of cos φ and power factor
- Up to 8 configurable alarms each with 2 conditions (and, or)
- Recording of the last 64 overruns with time/date-stamping
- Energy management by recording 1 to 8 load curves chosen among 10 measured or calculated quantities: P+, P-, Q1, Q2, Q3, Q4, S+, S-, On-off1 and On-off2 (integration time 10 minutes to 60 minutes)
- 2 configurable inputs (metering, on-off)
- 2 configurable outputs (alarm, pulse or analogue: ±20 mA)
- Communication
 - via optical interface
 - via RS485 link with ModBus protocol
 - via Ethernet with ModBus/TCP protocol
- 1 external synchronization input
- Software updating and upgrading via the optical interface (option)
- Large backlit 10 x 128-pixel graphic screen
- Measurement on 400 Hz networks

- Measurement of the 1s, min., max. and avg. values of the electrical quantities
- Energy metering in all 4 quadrants
- Measurement of harmonics by order up to the 25th order
- Measurement of THD-U, THD-V and THD-I, crest factor and composite voltage unbalance
- Measurement of cos φ and power factor
- Up to 8 configurable alarms, each with 2 conditions (and, or)
- Recording of the last 64 overruns with time/date-stamping
- Memorization of trend curves (up to 4) with a recording interval of 1 second to 60 minutes
- 4 configurable inputs (metering, on-off)
- 4 configurable outputs (alarm, pulse or analogue: ±20 mA)
- Communication :
 - via optical interface
 - via RS485 link with ModBus protocol
 - via Ethernet with ModBus/TCP protocol
- Software updating and upgrading via the optical interface (option)
- Wide 80 x 97 mm backlit screen
- Measurement on 400 Hz networks




Enerium 150

96 x 96 format

- Harmonics up to 50th order
- 2 inputs or 2 outputs
- 8 load curves
- 4 trend curves
- Graphs (Fresnel, bargraph, etc.)

772

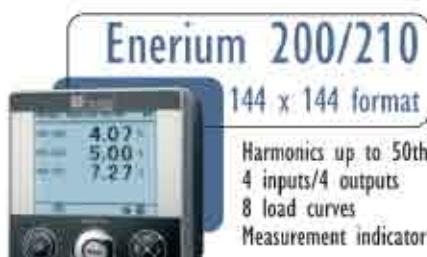

Enerium 200/210

144 x 144 format

- Harmonics up to 50th order
- 4 inputs/4 outputs
- 8 load curves
- Measurement indicator LED

772

- Same basic characteristics as the ENERIUM 50
- Measurement of harmonics up to 50th order
- Memorization of trend curves (up to 4) with a recording interval of 1 second to 60 minutes.
- Graphs
 - Fresnel diagram (network unbalance)
 - Bargraph of harmonics
 - U, I and P displayed as gauges

- Same basic characteristics as the ENERIUM 100/110
- Measurement of harmonics by order up to 50th order
- Energy management: by recording the load curves of 1 to 8 quantities chosen among 12 (P+, P-, Q1, Q2, Q3, Q4, S+, S-, On-off1, On-off2, On-off3, On-off4) with an adjustable integration period (34 days' recording with an integration period of 10 minutes, for example).



A version without a display (ENERIUM 110 and 210) for mounting on DIN rail or on a plate in a cabinet



An optical interface with 3 functions:

- Programming
- Verification
- Upgrading



An Ethernet output using the ModBus TCP protocol, an RS485 or ModBus/JBus protocol



Up to 8 configurable inputs (pulse, On-off, external synchronization) or outputs (pulse, analogue, On-off, alarms)



Measurement of earth-neutral voltage (with Enerium 100 and Enerium 200)




and its applications

- Whatever field you are working in, whether processing industries, infrastructures or tertiary production, you are affected by **energy efficiency** issues.

EXAMPLES OF APPLICATIONS

SCREENS

MAIN FEATURES

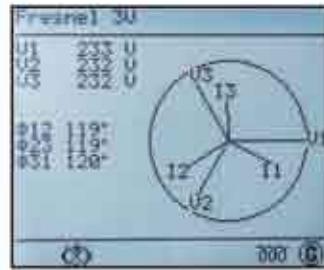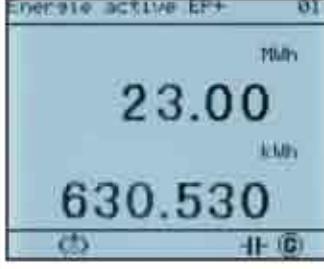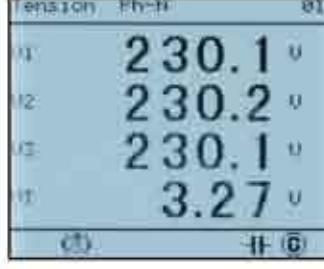ENERGY MANAGEMENT	MONITORING	SIZING	QUALITY
<ul style="list-style-type: none"> Measure all types of energy consumption and check billing Control costs and optimize consumption according to applicable rate contracts Allocate the costs per work centre Monitor active power consumption trends Class 0.5s (IEC 62053-22) Up to 8 configurable inputs/outputs for multi-energy measurement  	<ul style="list-style-type: none"> Monitor the functional parameters in real time and remotely Record all the essential electrical parameters of an installation Measure and analyse drift to avoid operating losses Manage alarms remotely, analyse the event log and verify circuit-breaker status Measure U and I with ±0.2% accuracy 	<ul style="list-style-type: none"> Assess the possibility of adding loads to a network or modifying a production process Define reactive energy compensation requirements: reduced penalties, increase in available active energy depending on long process variations Find out the transformer's load rate Simultaneously record 4 trend curves chosen among 12 quantities measured or calculated by the product 	<ul style="list-style-type: none"> Investigate the possible causes of dysfunction linked to harmonics Evaluate the way electrical equipment ages Assess distorting power due to harmonics Measure the harmonics per order and per phase: <ul style="list-style-type: none"> - phase-to-earth and phase-to-phase voltage - current up to order 50 (25 for Enerium 100/110)
<ul style="list-style-type: none"> Load curves for each type of energy measured Automatic reconstitution of total consumption index  	<ul style="list-style-type: none"> Measure energy in all 4 quadrants in class 0.5s Measure the earth-neutral voltage Display and record instant, minimum, maximum, average minimum and average maximum values 8 alarms with "and" or "or" conditions Log of last 64 events Verify correct wiring order Monitor electrical network balance Monitor alarm status locally (flashing on screen) 	<ul style="list-style-type: none"> Measure and record the cos ϕ and power factor per phase (average and instantaneous in all 4 quadrants) 	<ul style="list-style-type: none"> Measure THD-U, THD-V and THD-I Measure the unbalance

Specifications

◆ Special features

	ENERIUM 50	ENERIUM 100	ENERIUM 110	ENERIUM 150	ENERIUM 200	ENERIUM 210
Measurements						
Format	96 x 96 mm	144 x 144 mm	144 x 144 mm	96 x 96 mm	144 x 144 mm	144 x 144 mm
Graphic LCD screen	x	x	without display	x	x	without display
Neutral current	calculated	measured	measured	calculated	measured	measured
Harmonics	25th order	25th order	25th order	50th order	50th order	50th order
tan ϕ	x	-	-	x	-	-
Inputs (option)						
Number	2	4	4	1	4	4
Type				alarm, pulse, analogue		
Outputs (option)						
Nombre	2	4	4	2	4	4
Type				alarm, impulsion, analogique		
Input/output cards						
Option cards	1	4	4	1	4	4
Curves						
Load curves	8	-	-	8	-	-
Trend curves	-	-	4	-	4	-
Communication Interface						
Optical	front	front and rear	front	front	front and rear	front and rear
Ethernet or RS 485	x	x	x	x	x	x
Measurement indicator LED	-	x	x	-	x	x
Graphics						
Fresnel	-	-	-	x	-	-
Gauges	-	-	-	x	-	-
Bar graph	-	-	-	x	-	-

◆ General specifications

	TS	MIN	MAX	AVG	Avg Min	Avg Max
V1, V2, V3, Yearth	*	*	*	*	*	*
U12, U23, U31	*	*	*	*	*	*
I1, I2, I3, In	*	*	*	*	*	*
P1, P2, P3	*	*	*	*	*	*
Pt	*	*	*	*	*	*
Q1, Q2, Q3	*	*	*	*	*	*
Qt	*	*	*	*	*	*
S1, S2, S3	*	*	*	*	*	*
Sf	*	*	*	*	*	*
FP1, FP2, FP3	*			*		
FPt	*			*	*	*
Cos ϕ 1, Cos ϕ 2, Cos ϕ 3	*			*		
Cos ϕ t	*			*	*	*
tan ϕ	*					
frequency	*	*	*	*	*	*
Gross factor V1, V2, V3	*			*		*
Gross factor I1, I2, I3	*			*		*
U unbalance	*			*		*
Harmonics (1) 0 to 50 V1,V2, V3, U12, U23, U31, I1, I2, I3	*					*
THD V1, V2, U12, U23, U31, I1, I3	*			*		*
3 hour meter: network presence, under load, auxiliary source	*					
Active energy - receiver, generator	*					
Reactive energy Qcad1, Qcad2, Qcad3, Qcad4	*					
Reactive energy - receiver, generator	*					
Metering pulse input A1, A2, B1, B2, C1, C2, D1, D2	*					

(1) Measurement also possible in generator and receiver modes (2) Up to 25th order with ENERIUM 50/100/110

Voltage inputs	
Measurement range	10 to 120 % of U_n when $U_n = 230 \text{ V}$ (ph-N) 10 to 120 % of U_n when $U_n = 400 \text{ V}$ (ph-ph)
Frequency	50/60Hz or 400Hz
Max. composite voltage measured	450 kV
Admissible overvoltage	800 V during 24 hours 552 V permanent
Consumption	< 0.1 VA
Input impedance	2 MΩ (500 kΩ on ENERIUM 50/150)
Current inputs	
Measurement range	5 to 130 % of I_n when $I_n = 5 \text{ A}$
CT secondary (A)	1 to 5 A
Max. current measured	25,000 A
Admissible overload	6.5 A permanent 250 A for 1 second, 5 times every 3 minutes
Consumption	< 0.15 VA
Digital inputs (on-off or metering pulse)	
Operating voltage	24 to 60 Vdc ± 20 %
Minimum signal width	30 ms
Consumption	< 0.3 W
Auxiliary power supply	
Power supply	80 to 276 Vac / 80 to 264 Vdc (< 15 VA) 19.2 to 57 Vdc *
Multiple measurements (accuracy)	
Current I	± 0.2 % from 5 to 130 % of I_n
Voltage U or V	± 0.2 % from 10 to 120 % of U_n/V_n
Active power P	± 0.5 %
Reactive power Q	± 1 %
Apparent power S	± 0.5 %
Frequency F	正確為 +10mHz 証書 ± 0.1 Hz from 42.5 to 49 Hz
Power factor FP and cos φ	± 0.02 counts when 0.5 inductive < FP > 0.5 capacitive ± 0.05 counts when 0.2 inductive < FP > 0.2 capacitive
Sampling rate	6.6 kHz to 50 Hz - measurement without sample loss (0 alias)
Metering (accuracy)	
Active energy	Class 0.5s according to IEC 62053-22
Reactive energy	Class 2 according to 62053-23
Apparent energy	± 0.5 %
Qualimetry (accuracy)	
THD-I, THD-U and THD-V	± 0.5 counts
Order by order, U, V, I	± 0.5 counts
Pulse outputs or alarm relays	
Type	static relay
Operating voltage	24 to 110 Vdc ± 20 % 24 to 115 Vac - 10 % + 15 %
Max. current	100 mA
Compliant with standard	CEI 62053-31
Analogue output	
Scale	configurable between -10 mA and +10 mA
Admissible load	500 Ω, 10 V/I output
Response time	< 500 ms
RS 485 output	
Connection	2 wires, half-duplex
Protocol	ModBus/Tbus mode RTU
Speed (configurable)	2,400, 4,800, 9,600, 19,200, 38,400 (115 200 ENERIUM 50/150)
Parity	even, odd or none
Bus addresses	1 to 247
Ethernet output	
Type	RJ45 8-pin connector
Protocol	Modbus/TCP
Speed (configurable)	Compatible with 10baseT

* available as an option

Environmental specifications

Climatic specifications

Operating temperature	-10 °C to +55 °C
humidity during operation	95% at 40°C
storage temperature	-25 °C to +70 °C

Safety specifications

Pollution degree	2
Fire resistance	UL94, severity V1
Installation category	3

Mechanical characteristics

Ingress protection	front panel IP51 - rear IP20
Mechanical shock	IEC 61010-1
Vibrations	IEC 60068-2-6 (method 3A)
Fuse fill with packaging	MF H 0062-1
Electromagnetic compatibility	
Generic standard	IEC 61326-1

Mechanical specifications

Weight	850g (ENERIUM 100/200) 700g (ENERIUM 110/210) 600g (ENERIUM 50/150)
Mounting	DIN 43700 (ENERIUM 50/100/150/200)
Format	DIN 96x96 (ENERIUM 50/150) & DIN 144x144 (ENERIUM 100/110/300/210)
Connection	screw-lock terminal strip for direct rigid or flexible wires or current measurement inputs and 2.5mm² for the other accesses

Specifications

Trend curves

1S VALUES	
Il, I2, I3, In	*
Pt	*
Qt	*
Ss	*
FPt	*
U imbalance	*
THD V1, V2, V3	*
THD U12, U23, U31	*
THD Il, I2, I3	*
AVERAGE VALUES	
V1, V2, V3	*
Il, I2, I3, In	*
P1 Gen, P1 Rec, P2 Gen,	*
P2 Rec, P3 Gen, P3 Rec	*
Pt Gen, Pt Rec	*
FP1 Gen, FP1 Rec, FP2 Gen	*
FP2 Rec, FP3 Gen, FP3 Rec	*
FPt Gen, FPt Rec	*
Cosq1 Gen, Cosq2 Gen, Cosq3 Gen	*
Cosq1 Rec, Cosq2 Rec, Cosq3 Rec	*
Frequency	*
Crest factor V1, V2, V3	*
Crest factor Il, I2, I3	*
THD U12, U23, U31	*
THD Il, I2, I3	*
THD Il, I2, I3	*
THD V1, V2, V3	*


Load curves

AVERAGE VALUES	
Pt Gen, Pt Rec	*
Qad1, Qad2, Qad3, Qad4	*
Ss Gen, Ss Rec	*
Input On-off1, On-off2, On-off3, On-off4	*


Connection configurations

ENERIUM 50/150


Unbalanced 3-phase, 3 wires + 3 CTs




Unbalanced 3-phase, 3 wires + 2 CTs



Unbalanced 3-phase, 4 wires + 3 CTs




Single-phase connection




ENERIUM 100/110 - ENERIUM 200/210


Unbalanced 3-phase, 4 wires + 4 CTs




Single-phase connection, 2 wires + 1 CT



Unbalanced 3-phase, 3 wires + 3 CTs




Unbalanced 3-phase, 4 wires + 3 CTs



Other configurations are possible: please contact us

To order

Dimensions

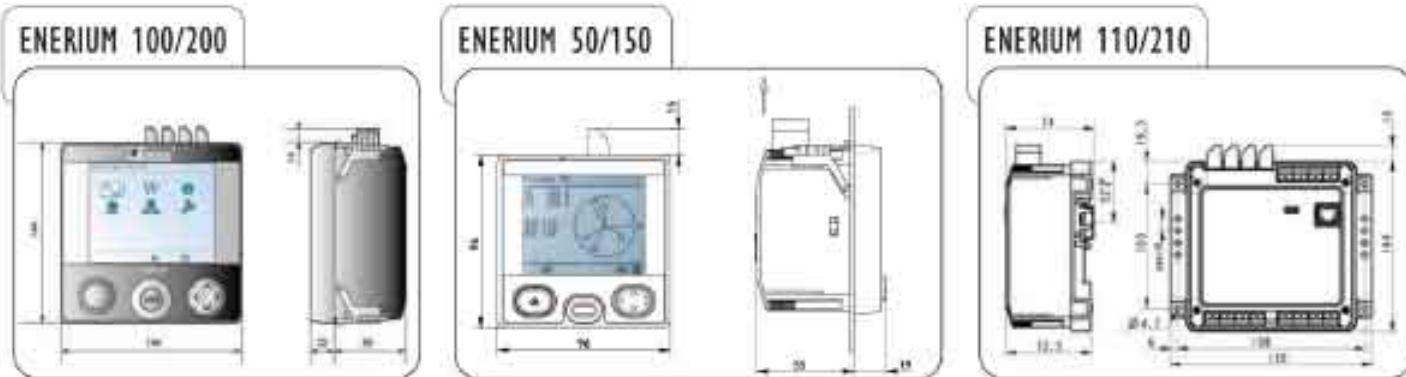

Standard product

Model	Frequency	Power supply	Communication	Metering input	On/off outputs	Analogic outputs	Reference
ENERIUM 100	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330801
ENERIUM 100	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	2	2	0	P01330802
ENERIUM 200	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	4	2	0	P01330803
ENERIUM 200	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	2	2	2	P01330804
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330805
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	0	0	P01330806
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	1	1	0	P01330807
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	1	1	0	P01330808
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330809
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	0	0	P01330810
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	2	0	P01330811
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	2	0	P01330812

Configured product

ENERIUM 1 2 3 4 5 6 7

1 Model	6 On/off outputs	Code
<input checked="" type="radio"/> 50 metering - with display <input type="radio"/> 100 metering - network monitoring + installation unit - with display <input type="radio"/> 110 metering - network monitoring + installation unit - without display <input type="radio"/> 150 metering - supervisio - with display <input type="radio"/> 200 metering - network monitoring + multi-energy management - with display <input type="radio"/> 210 metering - network monitoring + multi-energy management - without display	<input checked="" type="radio"/> 0 none <input type="radio"/> 1 1 output (ENERIUM 50/150 only) <input type="radio"/> 2 2 outputs <input type="radio"/> 4 4 outputs (not available for ENERIUM 50/150)	
2 Frequency of network measured :	7 Analogue outputs	
<input type="radio"/> 0 50/60Hz <input checked="" type="radio"/> 1 400Hz	<input checked="" type="radio"/> 0 none <input type="radio"/> 2 1 outputs	
3 Power supply	ACCESSORIES	
<input type="radio"/> 0 de 80 à 265 Vac / dc 80 à 264 Vdc <input checked="" type="radio"/> 1 de 19.2 à 58 Vdc	Optical interface for ENERIUM 50/150 Optical interface for ENERIUM 100/110 - 200/210 Elet software Enew software Enew+ software	P01330403 P01330401 P01330501 P01330601 P01330610
4 Communication		
<input type="radio"/> 0 RS485 <input checked="" type="radio"/> 1 Ethernet		
5 Metering (or on/off) inputs		
<input type="radio"/> 0 none <input type="radio"/> 1 1 input (ENERIUM 50/150 only) <input type="radio"/> 2 2 inputs <input type="radio"/> 4 4 inputs (not available for ENERIUM 50/150)		

Attention, for choices 5, 6 and 7, the maximum possible number of inputs and/or outputs is 8 (ENERIUM 100-110/200-210).

Attention, for Enerium 50/150, choices 5 and 6 only allow the following combinations: 0-0, 1-1, 2-0, 0-2.

Example: Enerium 200, frequency 50/60 Hz, auxiliary power supply 24 Vdc, RS485 communication, no outputs and 1 On/off input => order ENERIUM 200-910200
 • 1-200 • 2-0 • 3-1 • 4-0 • 5-2 • 6-0 • 7-0

Solutions

- ENERIUM is also a global solution with its associated **software**: configuration, installation diagnosis and display.



- Configure the power monitors in the ENERIUM range **remotely** via the RS485 network, the Ethernet network or the local area network using the optical interface.
- Program the products' communication parameters (address, speed, parity, etc.) and the configuration parameters (CT ratio, PT, alarm thresholds, etc.)



- Control the inputs and outputs of the power monitors in the ENERIUM range **remotely**
- Display the basic electrical parameters
- Retrieve the recordings of the load curves and trend curves, as well as the alarm log (format .cs, .xls, .txt).



- The same functions as the E.view software with additional tables, bargraphs and curves.

Functionalities	E.Set	E.view	E.view+
Description	*	*	*
Status	*	*	*
Configuratio	*	*	*
Diagnos	*	*	*
Display	*	*	*
Graphic			*

TO ORDER

Model	Reference
E.set software	P01330501
E.view software	P01330601
E.view+ software	P01330610