

# ENERIUM<sup>®</sup>

POWER MONITORS




- Communication and programming via optical interface, or remotely via **Ethernet network** or RS485 output
- **Energy:** measurement on all 4 quadrants in class 0.5s according to IEC 62053-22
- Up to **8 load curves**
- Up to **4 trend curves**
- **Display of harmonics** by order
- **8 inputs / outputs** as required
- Up to **8 configurable alarms**
- **Log of last 64 events**
- Possibility of upgrading the embedded software via the **optical interface**
- **Graphic display** (Enerium 150 only): Fresnel diagram, harmonics in bargraph form, U, I and P displayed as gauges
- Version without display for mounting in cabinet


**ETHERNET  
COMMUNICATION**

# The Range

◆ The ENERIUM range comprises six power monitors, including two without a display.

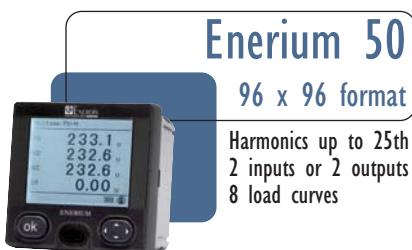


M 742

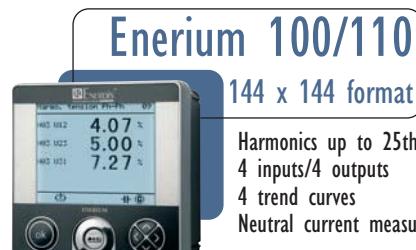


M 572

- Measurement of the 1s, min., max. and avg. values of the electrical quantities
- Energy metering in all 4 quadrants
- Measurement of harmonics by order up to the 25th order
- Measurement of THD-U,THD-V and THD-I, crest factor and composite voltage unbalance
- Measurement of cos φ and power factor
- Up to 8 configurable alarms each with 2 conditions (and, or)
- Recording of the last 64 overruns with time/date-stamping
- Energy management by recording 1 to 8 load curves chosen among 10 measured or calculated quantities: P+, P-, Q1, Q2, Q3, Q4, S+, S-, On-off1 and On-off2 (integration time 10 minutes to 60 minutes)
- 2 configurable inputs (metering, on-off)
- 2 configurable outputs (alarm, pulse or analogue: ±20 mA)
- Communication
  - o via optical interface
  - o via RS485 link with ModBus protocol
  - o via Ethernet with ModBus/TCP protocol
- 1 external synchronization input
- Software updating and upgrading via the optical interface (option)
- Large backlit 10 x 128-pixel graphic screen
- Measurement on 400 Hz networks

- Measurement of the 1s, min., max. and avg. values of the electrical quantities
- Energy metering in all 4 quadrants
- Measurement of harmonics by order up to the 25th order
- Measurement of THD-U,THD-V and THD-I, crest factor and composite voltage unbalance
- Measurement of cos φ and power factor
- Up to 8 configurable alarms, each with 2 conditions (and, or)
- Recording of the last 64 overruns with time/date-stamping
- Memorization of trend curves (up to 4) with a recording interval of 1 second to 60 minutes
- 4 configurable inputs (metering, on-off)
- 4 configurable outputs (alarm, pulse or analogue: ±20 mA)
- Communication :
  - o via optical interface
  - o via RS485 link with ModBus protocol
  - o via Ethernet with ModBus/TCP protocol
- Software updating and upgrading via the optical interface (option)
- Wide 80 x 97 mm backlit screen
- Measurement on 400 Hz networks

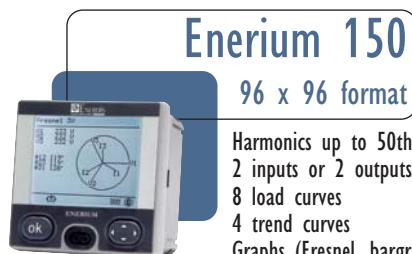

M 772

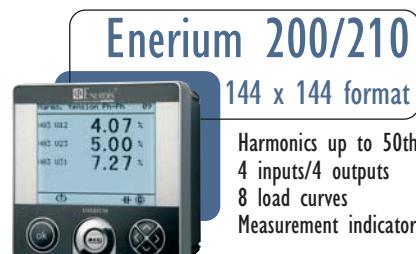

M 772

- Same basic characteristics as the ENERIUM 50
- Measurement of harmonics up to 50th order
- Memorization of trend curves (up to 4) with a recording interval of 1 second to 60 minutes.
- Graphs
  - o Fresnel diagram (network unbalance)
  - o Bargraph of harmonics
  - o U, I and P displayed as gauges

- Same basic characteristics as the ENERIUM 100/110
- Measurement of harmonics by order up to 50th order
- Energy management: by recording the load curves of 1 to 8 quantities chosen among 12 (P+, P-, Q1, Q2, Q3, Q4, S+, S-, On-off1, On-off2, On-off3, On-off4) with an adjustable integration period (34 days' recording with an integration period of 10 minutes, for example).




A version without a display (ENERIUM 110 and 210) for mounting on DIN rail or on a plate in a cabinet



An optical interface with 3 functions:  
 - Programming  
 - Verification  
 - Upgrading



An Ethernet output using the ModBus TCP protocol, an RS485 or ModBus/JBus protocol



Up to 8 configurable inputs (pulse, On-off, external synchronization) or outputs (pulse, analogue, On-off, alarms)



Measurement of earth-neutral voltage (with Enerium 100 and Enerium 200)

# and its applications

- Whatever field you are working in, whether processing industries, infrastructures or tertiary production, you are affected by **energy efficiency** issues.

EXAMPLES OF APPLICATIONS

SCREENS

MAIN FEATURES

## ENERGY MANAGEMENT



- Measure all types of energy consumption** and check billing
- Control costs and **optimize consumption** according to applicable rate contracts
- Allocate the costs** per work centre
- Monitor active power consumption** trends
- Class 0.5s** (IEC 62053-22)
- Up to **8 configurable inputs/outputs** for multi-energy measurement



- Load curves** for each type of energy measured
- Automatic reconstitution of **total consumption index**

## MONITORING



- Monitor** the functional parameters in real time and remotely
- Record all the essential electrical parameters** of an installation
- Measure and analyse drift** to avoid operating losses
- Manage alarms remotely**, analyse the event log and verify circuit-breaker status
- Measure U and I with **±0.2% accuracy**

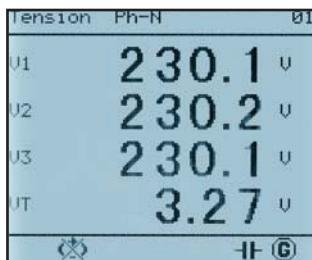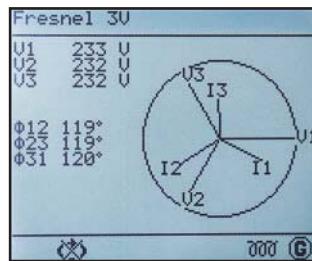

- Measure energy in all **4 quadrants in class 0.5s**
- Measure the earth-neutral voltage**
- Display and record** instant, minimum, maximum, average minimum and average maximum values
- 8 alarms** with "and" or "or" conditions
- Log of last 64 events**
- Verify correct wiring order**
- Monitor electrical network balance**
- Monitor alarm status locally (flashing on screen)

## SIZING


- Assess the possibility of **adding loads to a network** or modifying a production process
- Define **reactive energy compensation requirements**: reduced penalties, increase in available active energy depending on long process variations
- Find out the transformer's load rate
- Simultaneously **record 4 trend curves** chosen among 12 quantities measured or calculated by the product

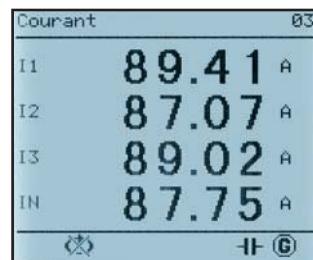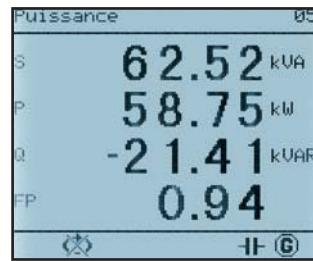

- Measure and record the **cos φ and power factor** per phase (average and instantaneous in all 4 quadrants)

## QUALITY

- Investigate** the possible causes of **dysfunction** linked to harmonics
- Evaluate** the way electrical equipment **ages**
- Assess distorting power due to harmonics
- Measure the harmonics** per order and per phase:
  - phase-to-earth and phase-to-phase voltage
  - current up to **order 50** (25 for Enerium 100/110)

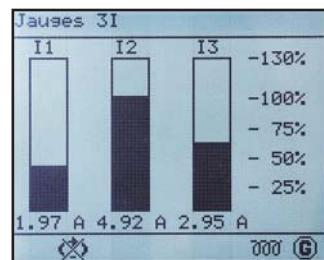

- Measure **THD-U, THD-V and THD-I**
- Measure the **unbalance**

# Specifications

## ◆ Special features

	ENERIUM 50	ENERIUM 100	ENERIUM 110	ENERIUM 150	ENERIUM 200	ENERIUM 210
<b>Measurements</b>						
Format	96 x 96 mm	144 x 144 mm	144 x 144 mm	96 x 96 mm	144 x 144 mm	144 x 144 mm
Graphic LCD screen	x	x	without display	x	x	without display
Neutral current	calculated	measured	measured	calculated	measured	measured
Harmonics	25th order	25th order	25th order	50th order	50th order	50th order
$\tan \varphi$	x	-	-	x	-	-
<b>Inputs (option)</b>						
Number	2	4	2	2	4	
Type	alarm, pulse, analogue					
<b>Outputs (option)</b>						
Nombre	2	4	2	2	4	
Type	alarme, impulsion, analogique					
<b>Input/output cards</b>						
Option cards	1	4	1	1	4	
<b>Curves</b>						
Load curves	8	-	-	8		
Trend curves	-	4	4	4		
<b>Communication interface</b>						
Optical	front	front and rear	front	front	front and rear	
Ethernet or RS 485	x	x	x	x	x	x
Measurement indicator LED	-	x	x	-	x	x
<b>Graphics</b>						
Fresnel	-	-	-	x	-	-
Gauges	-	-	-	x	-	-
Bargraph	-	-	-	x	-	-

## ◆ General specifications

	1 S	MIN	MAX	Avg	Avg Min	Avg Max
V1, V2, V3, Vearth	•	•	•	•		•
U12, U23, U31	•	•	•	•		•
I1, I2, I3, In	•	•	•	•		•
P1, P2, P3	•		• <sup>(1)</sup>	• <sup>(1)</sup>		
Pt	•	• <sup>(1)</sup>	• <sup>(1)</sup>	• <sup>(1)</sup>		• <sup>(1)</sup>
Q1, Q2, Q3	•		• <sup>(1)</sup>	• <sup>(1)</sup>		
Qt	•	• <sup>(1)</sup>	• <sup>(1)</sup>	• <sup>(1)</sup>		• <sup>(1)</sup>
S1, S2, S3	•		•	•		
St	•		•	•		•
FP1, FP2, FP3	•			• <sup>(1)</sup>		
FPt	•			• <sup>(1)</sup>	• <sup>(1)</sup>	• <sup>(1)</sup>
Cos $\varphi$ 1, Cos $\varphi$ 2, Cos $\varphi$ 3	•			• <sup>(1)</sup>		
Cos $\varphi$ t	•			• <sup>(1)</sup>	• <sup>(1)</sup>	• <sup>(1)</sup>
$\tan \varphi$	•					
Frequency	•	•	•	•		
Crest factor V1, V2, V3	•			•		•
Crest factor I1, I2, I3	•			•		•
U unbalance	•			•		•
Harmonics <sup>(2)</sup> 0 to 50 V1, V2, V3, U12, U23, U31, I1, I2, I3	•					•
THD V1, V2, U12, U23, U31, I1, I3	•			•		•
3 hour meters: network presence, under load, auxiliary source	•					
Active energy - receiver, generator	•					
Reactive energy Qcad1, Qcad2, Qcad3, Qcad4	•					
Reactive energy - receiver, generator	•					
Metering pulse input A1, A2, B1, B2, C1, C2, D1, D2	•					

(1) Measurement also possible in generator and receiver modes (2) Up to 25th order with ENERIUM 50/100/110

<b>Voltage inputs</b>	
Measurement range	10 to 120 % of $V_n$ when $V_n = 230$ V (ph-N) 10 to 120 % of $U_n$ when $U_n = 400$ V (ph-ph)
Frequency	50/60Hz or 400Hz
Max. composite voltage measured	650 KV
Admissible overvoltage	800 V during 24 hours 552 V permanent
Consumption	< 0.1 VA
Input impedance	2 MΩ (500 kΩ on ENERIUM 50/150)
<b>Current inputs</b>	
Measurement range	5 to 130 % of $I_n$ when $I_n = 5$ A
CT secondary ( $I_n$ )	1 to 5 A
Max. current measured	25,000 A
Admissible overload	6.5 A permanent 250 A for 1 second, 5 times every 5 minutes
Consumption	< 0.15 VA
<b>Digital inputs (on-off or metering pulse)</b>	
Operating voltage	24 to 60 Vdc ± 20 %
Minimum signal width	30 ms
Consumption	< 0.5 W
<b>Auxiliary power supply</b>	
Power supply	80 to 276 Vac / 80 to 264 Vdc (< 15 VA) 19.2 to 57 Vdc *
<b>Multiple measurements (accuracy)</b>	
Current I	± 0.2 % from 5 to 130 % of $I_n$
Voltage U or V	± 0.2 % from 10 to 120 % of $U_n/V_n$
Active power P	± 0.5 %
Reactive power Q	± 1 %
Apparent power S	± 0.5 %
Frequency F	正確為±10mHZ詳原廠證書 ± 0.1 Hz from 42.5 to 69 Hz
Power factor FP and cos φ	± 0.02 counts when 0.5 inductive < FP > 0.5 capacitive ± 0.05 counts when 0.2 inductive < FP > 0.2 capacitive
Sampling rate	6.4 KHz to 50 Hz - measurement without sample loss (0 blind)
<b>Metering (accuracy)</b>	
Active energy	Class 0.5s according to IEC 62053-22
Reactive energy	Class 2 according to 62053-23
Apparent energy	± 0.5 %
<b>Qualimetry (accuracy)</b>	
THD-I, THD-U and THD-V	± 0.5 counts
Order by order, U, V, I	± 0.5 counts
<b>Pulse outputs or alarm relays</b>	
Type	static relay
Operating voltage	24 to 110 Vdc ± 20 % 24 to 115 Vac - 10 % + 15 %
Max. current	100 mA
Compliant with standard	CEI 62053-31
<b>Analogue output</b>	
Scale	configurable between - 20 mA and + 20 mA
Admissible load	500 W, 10 V/I output
Response time	< 500 ms
<b>RS 485 output</b>	
Connection	2 wires, half-duplex
Protocol	ModBus/Jbus mode RTU
Speed (configurable)	2,400, 4,800, 9,600, 19,200, 38,400 (115 200 ENERIUM 50/150)
Parity	even, odd or none
Jbus addresses	1 to 247
<b>Ethernet output</b>	
Type	RJ45 8-pin connector
Protocol	Modbus/TCP
Speed (configurable)	Compatible with 10baseT

\* available as an option

## ◆ Environmental specifications

<b>Climatic specifications</b>	
Operating temperature	-10°C to +55°C
Humidity during operation	95% at 40°C
Storage temperature	-25°C to +70°C
<b>Safety specifications</b>	
Pollution degree	2
Fire resistance	UL94, severity V1
Installation category	3
<b>Mechanical characteristics</b>	
Ingress protection	front panel IP51 - rear IP20
Mechanical shocks	IEC 61010-1
Vibrations	IEC 60068-2-6 (method A)
Free fall with packaging	NF H 0042-1
<b>Electromagnetic compatibility</b>	
Generic standard	IEC 61326-1

## ◆ Mechanical specifications

Weight	850g (ENERIUM 100/200) 700g (ENERIUM 110/210) 600g (ENERIUM 50/150)
Mounting	DIN 43700 (ENERIUM 50/100/150/200)
Format	DIN 96x96 (ENERIUM 50/150) & DIN 144x144 (ENERIUM 100/110/200/210)
Connection	Screw-lock terminal strip for 6mm² rigid or flexible wires on current measurement inputs and 2.5mm² for the other accesses

# Specifications

## Trend curves

1S VALUES	
I1, I2, I3, In	•
Pt	•
Qt	•
St	•
FPt	•
U unbalance	•
THD V1, V2, V3	•
THD U12, U23, U31	•
THD I1, I2, I3	•
AVERAGE VALUES	
V1, V2, V3	•
I1, I2, I3, In	•
P1 Gen, P1 Rec, P2 Gen,	•
P2 Rec, P3 Gen, P3 Rec	•
Pt Gen, Pt Rec	•
FP1 Gen, FP1 Rec, FP2 Gen,	•
FP2 Rec, FP3 Gen, FP3 Rec	•
FPt Gen, FPt Rec	•
Coscp1 Rec, Coscp1 Gen, Coscp2 Rec,	•
Coscp2 Gen, Coscp3 Rec, Coscp3 Gen	•
Coscp Gen, Coscp Rec	•
Frequency	•
Crest factor V1, V2, V3	•
Crest factor I1, I2, I3	•
THD U12, U23, U31	•
THD I1, I2, I3	•
THD I1, I2, I3	•
THD V1, V2, V3	•


## Load curves

AVERAGE VALUES	
Pt Gen, Pt Rec	•
Qcad1, Qcad2, Qcad3, Qcad4	•
St Gen, St Rec	•
Inputs On-off1, On-off2, On-off3, On-off4	•


## Connection configurations

### ENERIUM 50/150


Unbalanced 3-phase, 3 wires + 3 CTs




Unbalanced 3-phase, 3 wires + 2 CTs



Unbalanced 3-phase, 4 wires + 3 CTs




Single-phase connection




### ENERIUM 100/110 - ENERIUM 200/210


Unbalanced 3-phase, 4 wires + 4 CTs




Single-phase connection, 2 wires + 1 CT



Unbalanced 3-phase, 3 wires + 3 CTs



Unbalanced 3-phase, 4 wires + 3 CTs




Other configurations are possible: please contact us


# To order

## Dimensions


**ENERIUM 100/200**

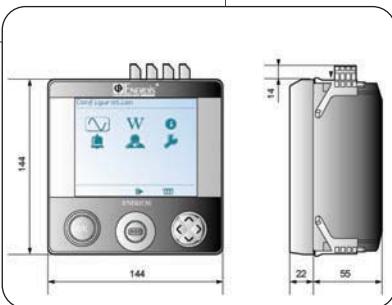

**ENERIUM 50/150**

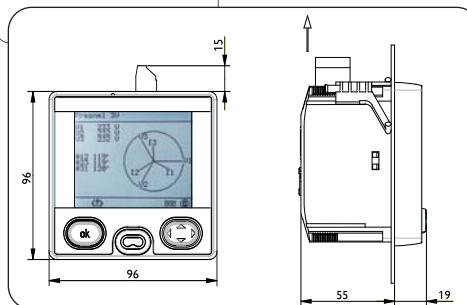

**ENERIUM 110/210**

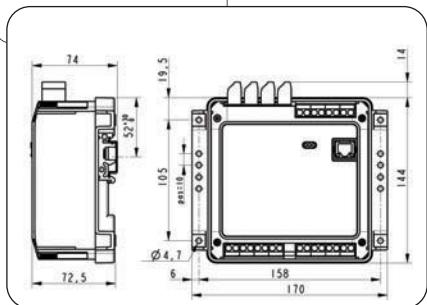

## Standard product

Model	Frequency	Power supply	Communication	Metering input	On-off outputs	Analogue outputs	Reference
ENERIUM 100	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330801
ENERIUM 100	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	2	2	0	P01330802
ENERIUM 200	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	4	2	0	P01330803
ENERIUM 200	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	2	2	2	P01330804
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330805
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	0	0	P01330806
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	1	1	0	P01330807
ENERIUM 50	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	1	1	0	P01330808
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	0	0	P01330809
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	0	0	P01330810
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	RS485	0	2	0	P01330811
ENERIUM 150	50/60 Hz	80 to 265 Vac / 80 to 264 Vdc	Ethernet	0	2	0	P01330812

## Configured product

**ENERIUM 1 2 3 4 5 6 7**

**1 Model**

- 50** metering - with display
- 100** metering - network monitoring + installation sizing - with display
- 110** metering - network monitoring + installation sizing - without display
- 150** metering - supervision - with display
- 200** metering - network monitoring + multi-energy management - with display
- 210** metering - network monitoring + multi-energy management - without display

**2 Frequency of network measured :**

- 0** 50/60Hz
- 1** 400Hz

**3 Power supply**

- 0** de 80 à 265 Vac / de 80 à 264 Vdc
- 1** de 19.2 à 58 Vdc

**4 Communication**

- 0** RS485
- 1** Ethernet

**5 Metering (or on-off) inputs**

- 0** none
- 1** 1 input (ENERIUM 50/150 only)
- 2** 2 inputs
- 4** 4 inputs (not available for ENERIUM 50/150)

**6 On-off outputs**

- 0** none
- 1** 1 output (ENERIUM 50/150 only)
- 2** 2 outputs
- 4** 4 outputs (not available for ENERIUM 50/150)

**7 Analogue outputs**

- 0** none
- 2** 2 outputs

**ACCESSORIES:**

- Optical interface for ENERIUM 50/150 **P01330403**
- Optical interface for ENERIUM 100/110 - 200/210 **P01330401**
- E.Set software **P01330501**
- E.View software **P01330601**
- E.View+ software **P01330610**

Attention, for choices 5, 6 and 7, the maximum possible number of inputs and/or outputs is 8 (ENERIUM 100-110/200-210).

Attention, for Enerium 50/150, choices 5 and 6 only allow the following combinations: 0-0, 1-1, 2-0, 0-2.


Example: Enerium 200, frequency 50/60 Hz, auxiliary power supply 24 Vdc, RS485 communication, no outputs and 2 On-off inputs => order ENERIUM 200 010200  
 • 1-200   • 2-0   • 3-1   • 4-0   • 5-2   • 6-0   • 7-0

# Solutions


- ENERIUM is also a global solution with its associated **software**: configuration, installation diagnosis and display.



- Configure** the power monitors in the ENERIUM range **remotely** via the RS485 network, the Ethernet network or the local area network using the optical interface
- Program** the products' communication parameters (address, speed, parity, etc.) and the configuration parameters (CT ratio, PT, alarm thresholds, etc.)

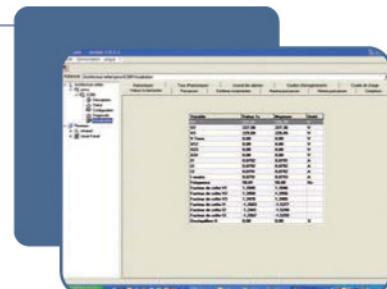

- Control** the inputs and outputs of the power monitors in the ENERIUM range remotely
- Display** the basic electrical parameters
- Retrieve** the recordings of the load curves and trend curves, as well as the alarm log (format .cs, .xls, .txt).

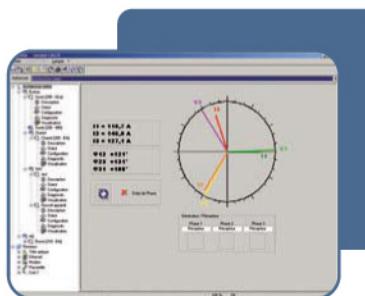

- The same functions as the E.view software** with additional **tables, bargraphs and curves**.

Functionalities	E.Set	E.view	E.view+
Description	•	•	•
Status	•	•	•
Configuration	•	•	•
Diagnosis		•	•
Display		•	•
Graphics			•

T O O R D E R

Model	Reference
E.Set software	P01330501
E.View software	P01330601
E.View+ software	P01330610